

waterXcite



**ECO** Power solutions  
gmbh 

# SOLUTIONS FOR LIFE

WATER TREATMENT & BEYOND

# waterXcite *BOTTLE*

## VITALIZING WATER



The waterXcite bottle (1 liter) uses a bio energetic effect to vitalize the water.

This Bio Energetic water stimulates the metabolism by activating the body's cell structure.

Harmful substances such as toxins are then naturally eliminated from the Body.

This is very effective in supporting a sensitive diet.

The total effect of Bio Energetic Cell stimulation is achieved by the manipulation and harmonization of the energy within the cell structure of the water.

Twenty years of Bio research in our Austro / German Laboratories has enabled this remarkable and unique product.

# waterXcite *BOTTLE*

- **Activates the body's cells to eliminate toxic substances**
- *Stimulates the metabolism*
- *Supports sensitive diet*

# waterXcite *BOTTLE*

## INSTRUCTIONS



Fill the bottle with fresh water and let it stand for at least 2 hours prior to drinking.

This enables the full vitalization to be achieved for maximum effect.

Drink a minimum of at least three bottles a day!


# waterXcite *BOTTLE*





# waterXcite

*IMPROVEMENT STICK*

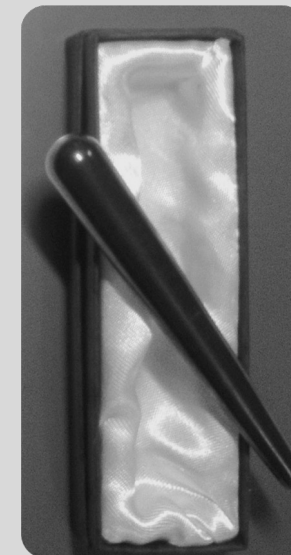

*The water tastes fresh  
and soft as of the natural  
source.*

*Drinking tea or coffee  
becomes a completely  
new experience!*



**waterXcite**  
IMPROVEMENT STICK

The **waterXcite** STICK uses a bio energetic effect to vitalize the water.

This causes a reduction of impairing elements in the water and the improvement in already available positive elements.

The effect of the **waterXcite** STICK is based on bio energetic basis by harmonisation of energy constellations.

Please clean the surface of the uncoated pipe!  
Simply install the **waterXcite** STICK with 2 ties or adhesive tape on the main water pipe with a max diameter of 2 inch.  
The change in water happens fast.  
Enjoy your fresh and new tasting water !

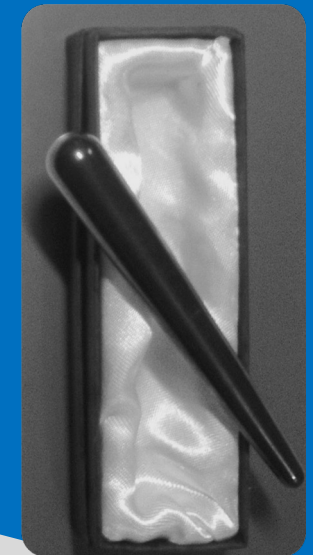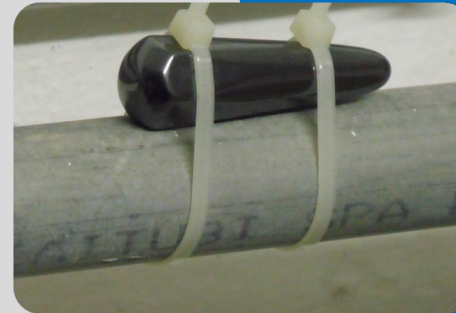



Abridgement-wateranalysis 2009/06/10

Description	Item	Result	max.	TWV 304/2001 Parameter-values	TWV 304/2001 Indicator-values	Method
Chloride (Cl)	mg/l	21,00	1		200	EN ISO 10304-1
Nitrate (NO3)	mg/l	10,10	1	50		EN ISO 10304-1
Nitrate/50 + Nitrit/3	mg/l	0,21		1		no decleration
bacterium at 22°C	KBE/1ml	25,00	10		100	EN ISO 6222 after 72 h
Iron (FE)	mg/l	0,04	0,01		0,2	EN ISO 11885



Abridgement-wateranalysis 2010/05/17

Description	Item	Result	max.	TWV 304/2001 Parameter-values	TWV 304/2001 Indicator-values	Method
Chloride (Cl)	mg/l	16,50	1		200	EN ISO 10304-1
Nitrate (NO3)	mg/l	7,80	1	50		EN ISO 10304-1
Nitrate/50 + Nitrit/3	mg/l	0,16		1		no decleration
bacterium at 22°C	KBE/1ml	<10	10		100	EN ISO 6222 after 72 h
Iron (FE)	mg/l	<0,01	0,01		0,2	EN ISO 11885

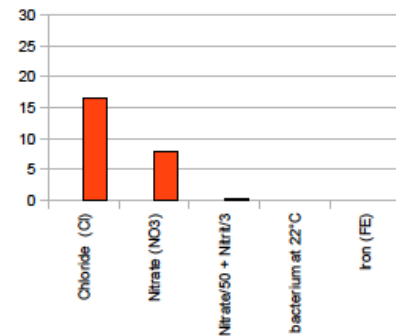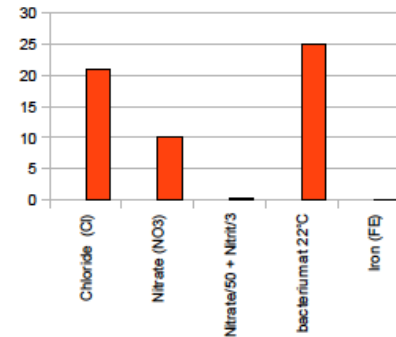

„ANALYSIS“



**ECO** Power energy solutions

CREATIVITY DRIVES OUR INNOVATIONS

**ECO** Power solutions   
THE CORE FOR ENERGY OPTIMIZATION

ECOPower solution GmbH  
Altwirthgasse 1, Top 2  
1230 Vienna, Austria  
office@ecopower.eu.com

**ECO** Power **ASIA-PACIFIC**  
FAIR ENERGY OPTIMIZATION

ECOPower ASIA-PACIFIC Co., Ltd.  
No.2/23 Moo.2, T.Samed A.Mueng  
Chonburi Province, Thailand  
office@ecopower-asiapacific.com